


NOTE:  
ALL PIPING SHALL  
BE CAST IRON OR  
PVC SCHEDULE 40  
4" MIN. DIA.

FRAMES & LIDS, AS PER DEKALB SANITARY DISTRICT DETAIL AND  
ADJUSTING RINGS AS NEEDED (4" MAX HEIGHT) w/ MASTIC SEAL.

NOTE:  
4000 P.S.I. CONCRETE  
@ 28 DAYS SHALL BE  
USED THROUGHOUT

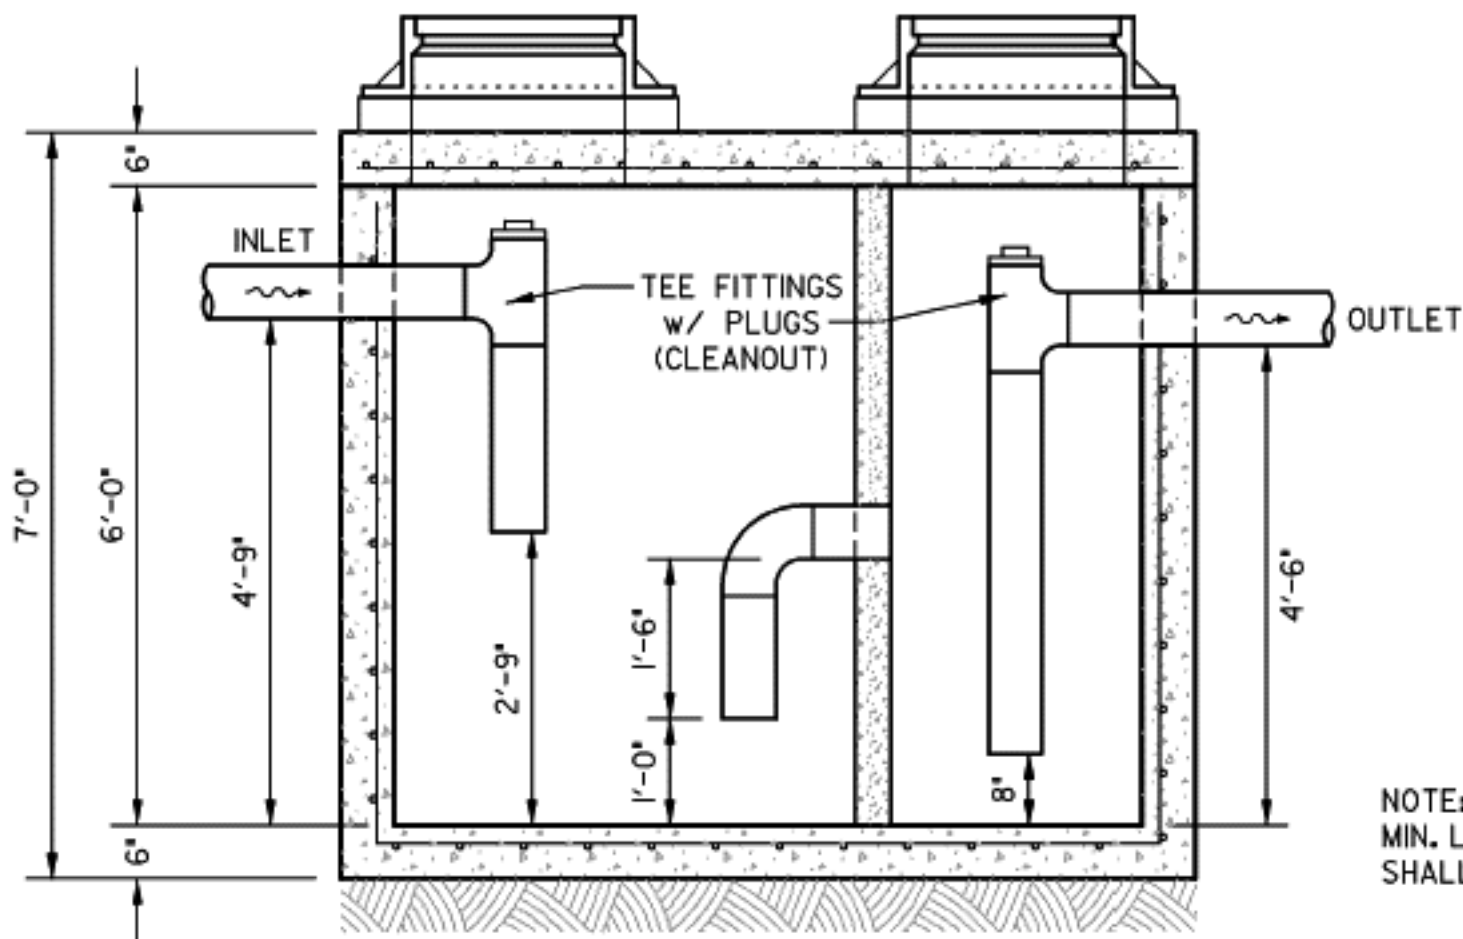

NOTE:  
MIN. LIQUID CAPACITY  
SHALL BE 1000 GALS.

**NOTES:**

1. INSTALLATION OF GREASE INTERCEPTOR STRUCTURE SHALL BE IN ACCORDANCE WITH ALL OTHER APPLICABLE STANDARDS FOLLOWED BY THE DEKALB SANITARY DISTRICT.
2. SHOP DRAWINGS SHALL BE SUBMITTED TO THE DISTRICT FOR APPROVAL WHEN PREMANUFACTURED STRUCTURES ARE TO BE USED.

*DeKalb Sanitary District*

303 Hollister Avenue • DeKalb, Illinois 60115  
815.758.3513 Fax: 815.758.6615

DETAIL No. 25

**Precast Reinforced Concrete  
Grease Interceptor Detail**

DATE: 06/12/07

REV. 1